

Private Stairs

2010 National Building Code of Canada

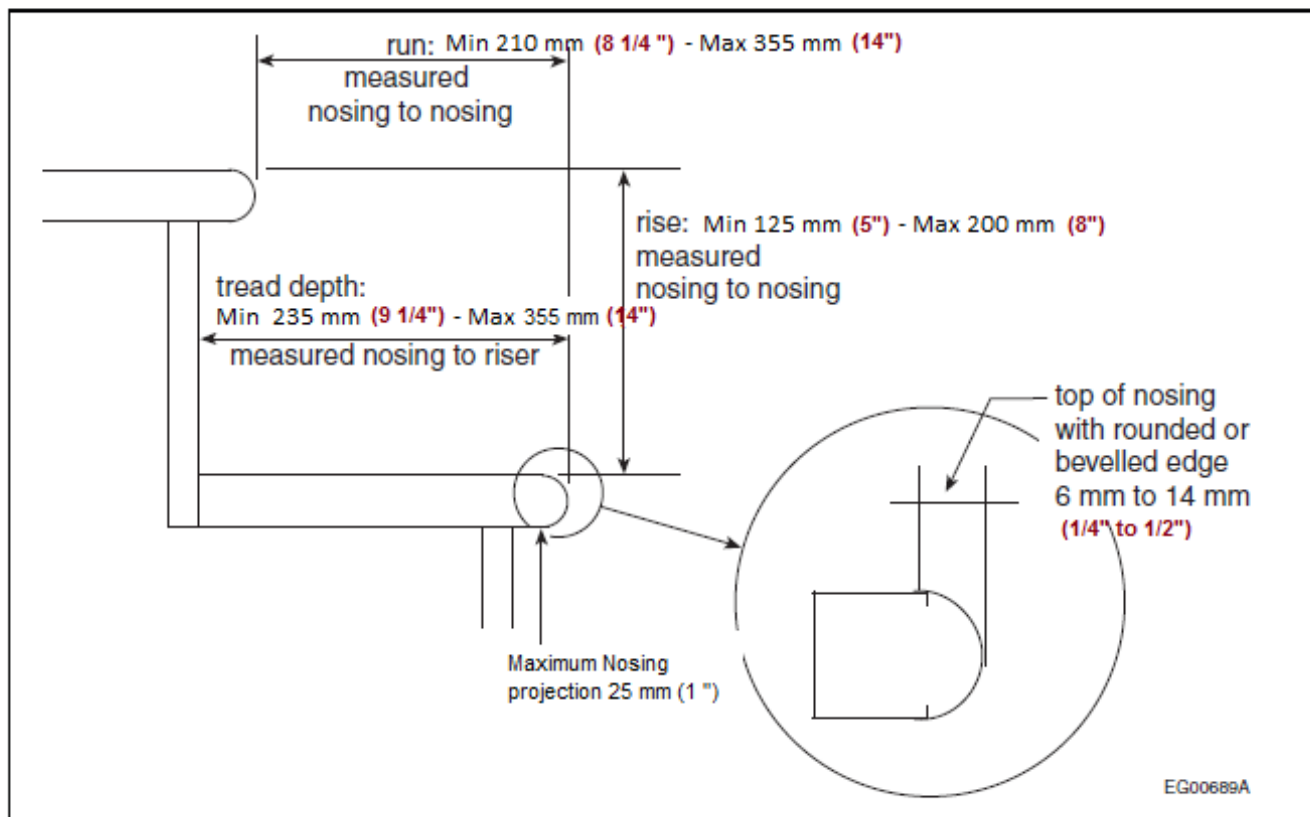


Figure A-9.8.4.-B Measurements shown are interior or exterior stairs serving (a) single dwelling units, (b) houses with a secondary suite or garages serving a or b
Elements of steps and their measurement

Risers and Treads shall be of uniform height and run in any one flight, with a maximum tolerance of 5 mm between adjacent treads or landings and 10 mm between the tallest and shortest risers and deepest and shallowest treads in a flight.